


Fire Weather Climatology
and
Current (2017) Conditions
for
BC: PALLISER Weather Station
as of
September 06, 2017

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Temperature

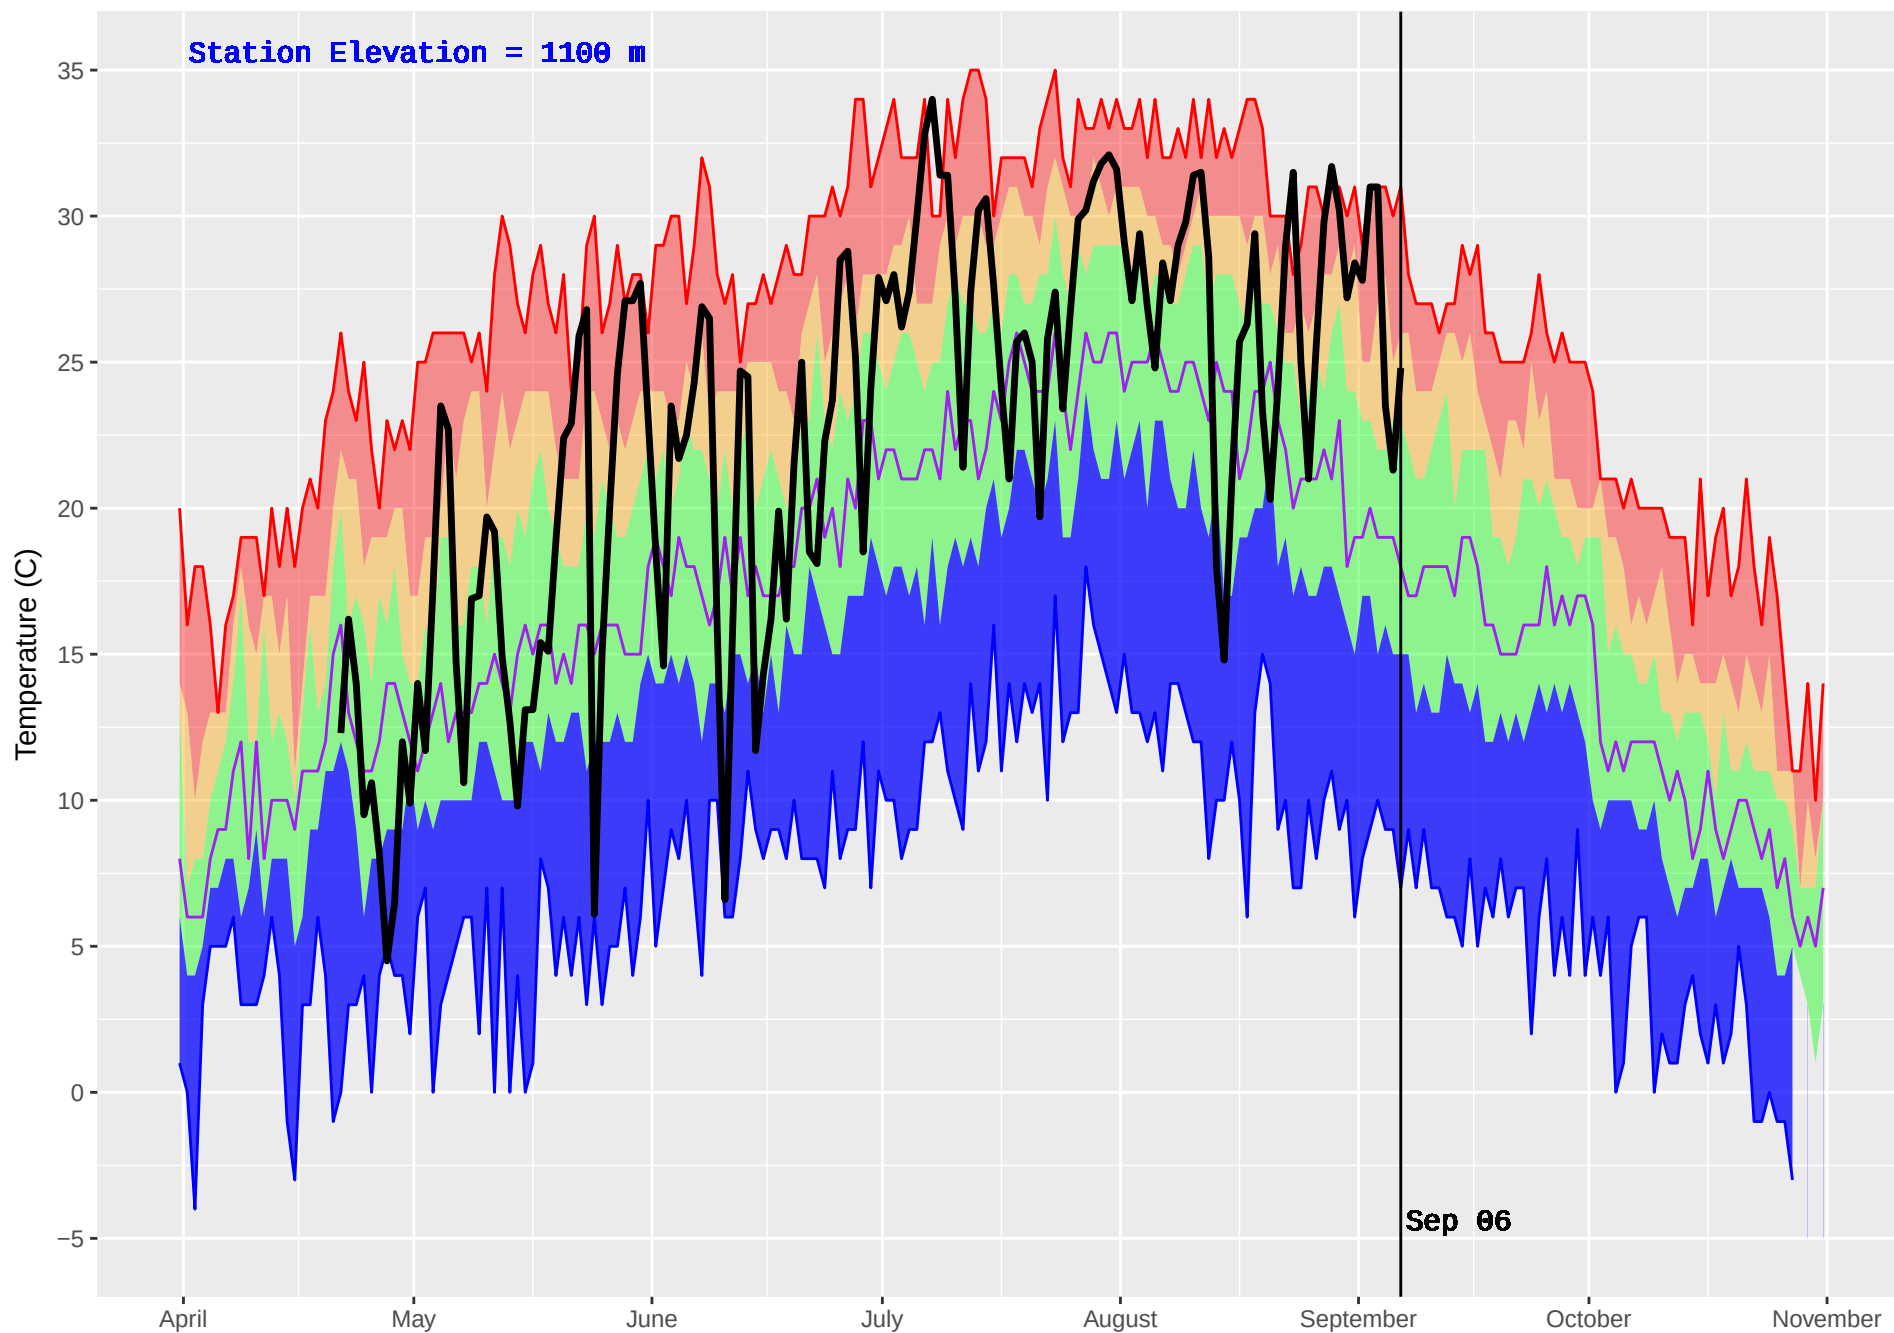

Percentiles (0 – 100%)

Extreme 90+

Above Normal 75-90


Normal 25-75

Below Normal 0-25

2017 Data

Historical Median

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Relative Humidity

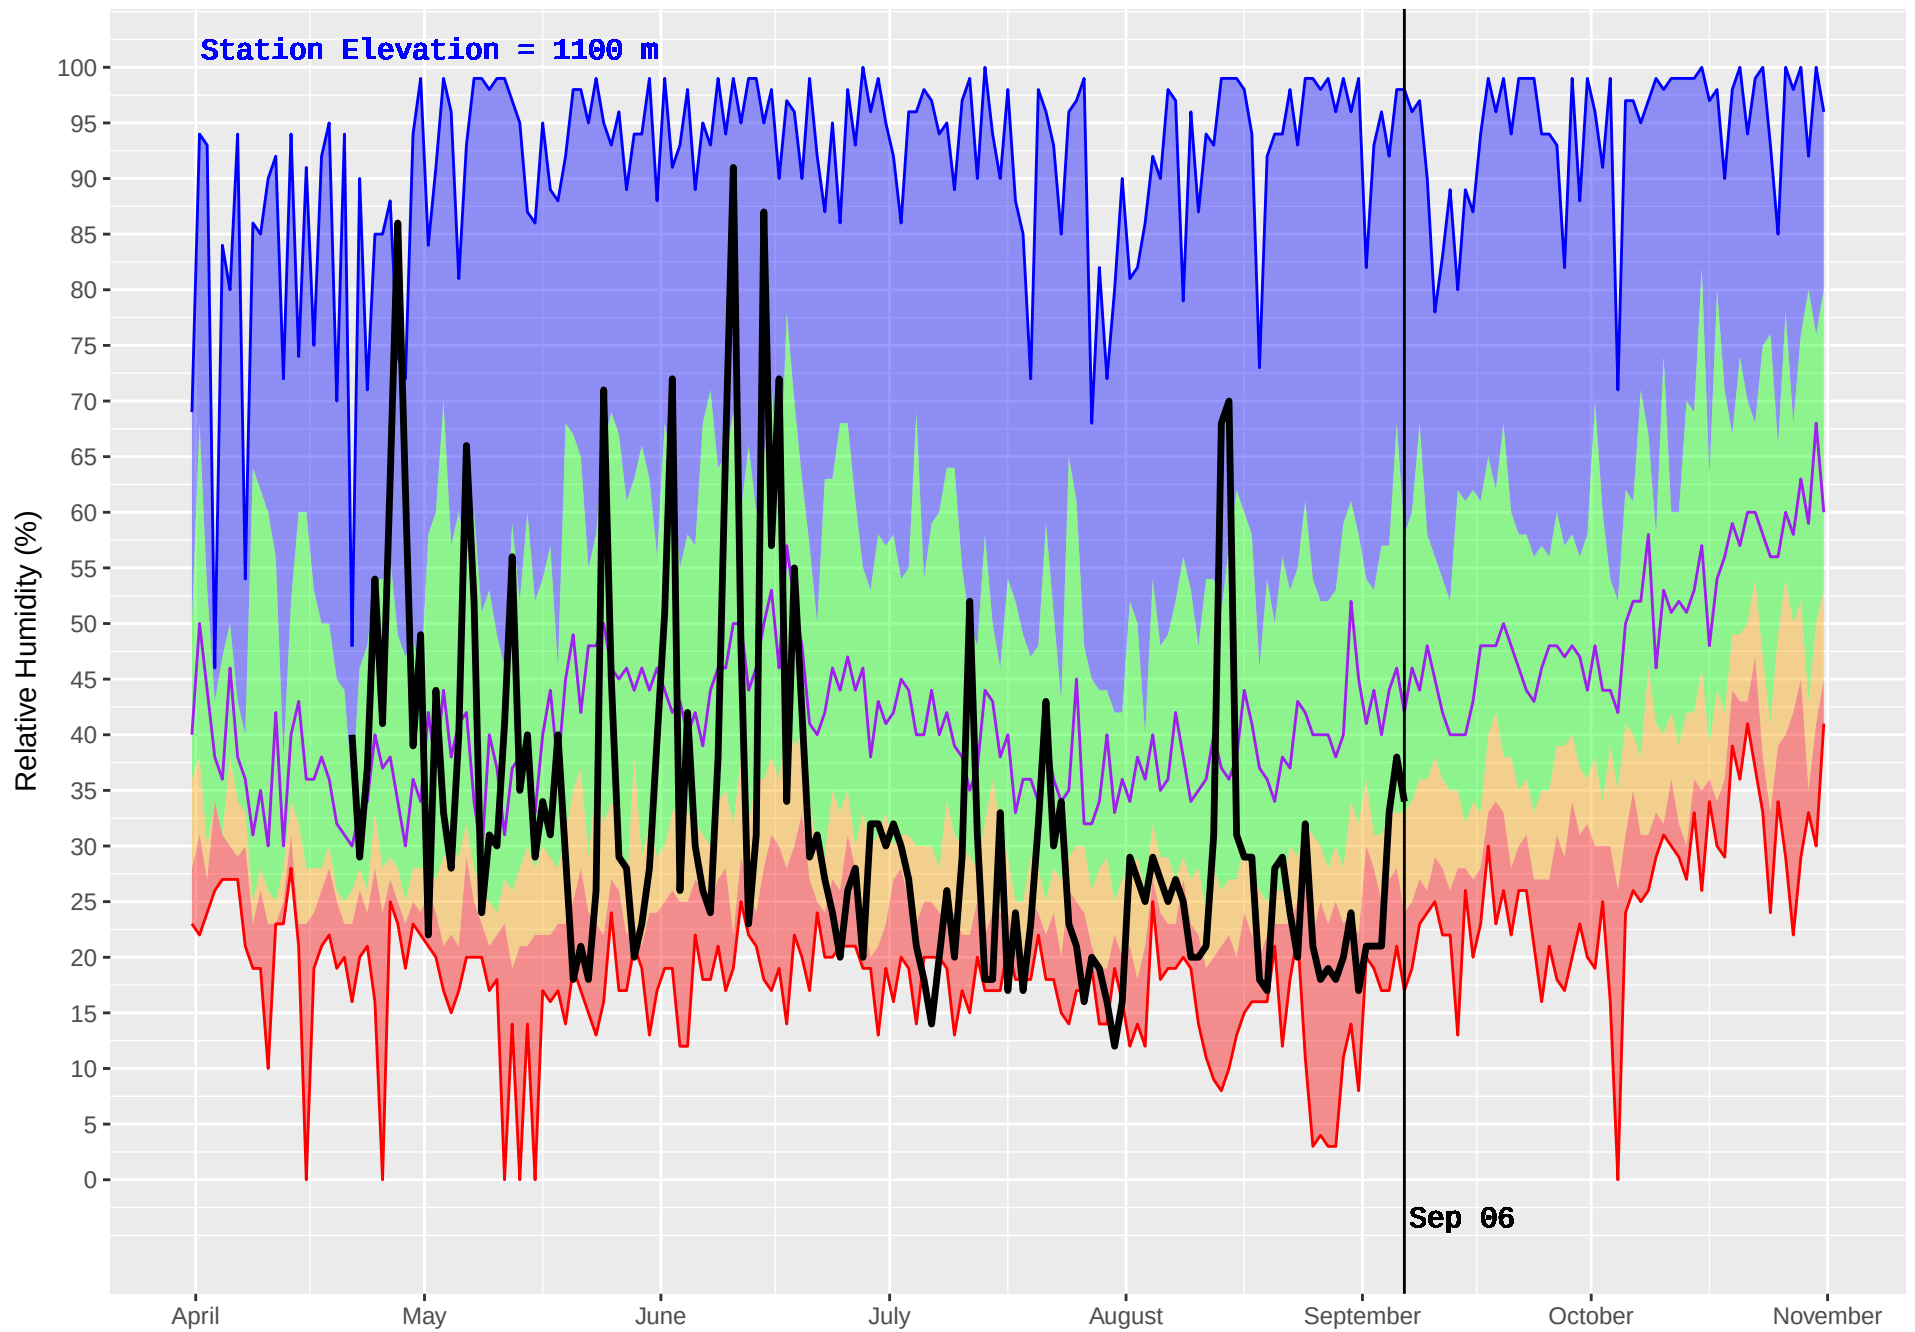

Percentiles (0 – 100%)

Above Normal 75+

Normal 25–75


Below Normal 10–25

Extreme < 10


2017 Data

Historical Median


PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Wind Speed

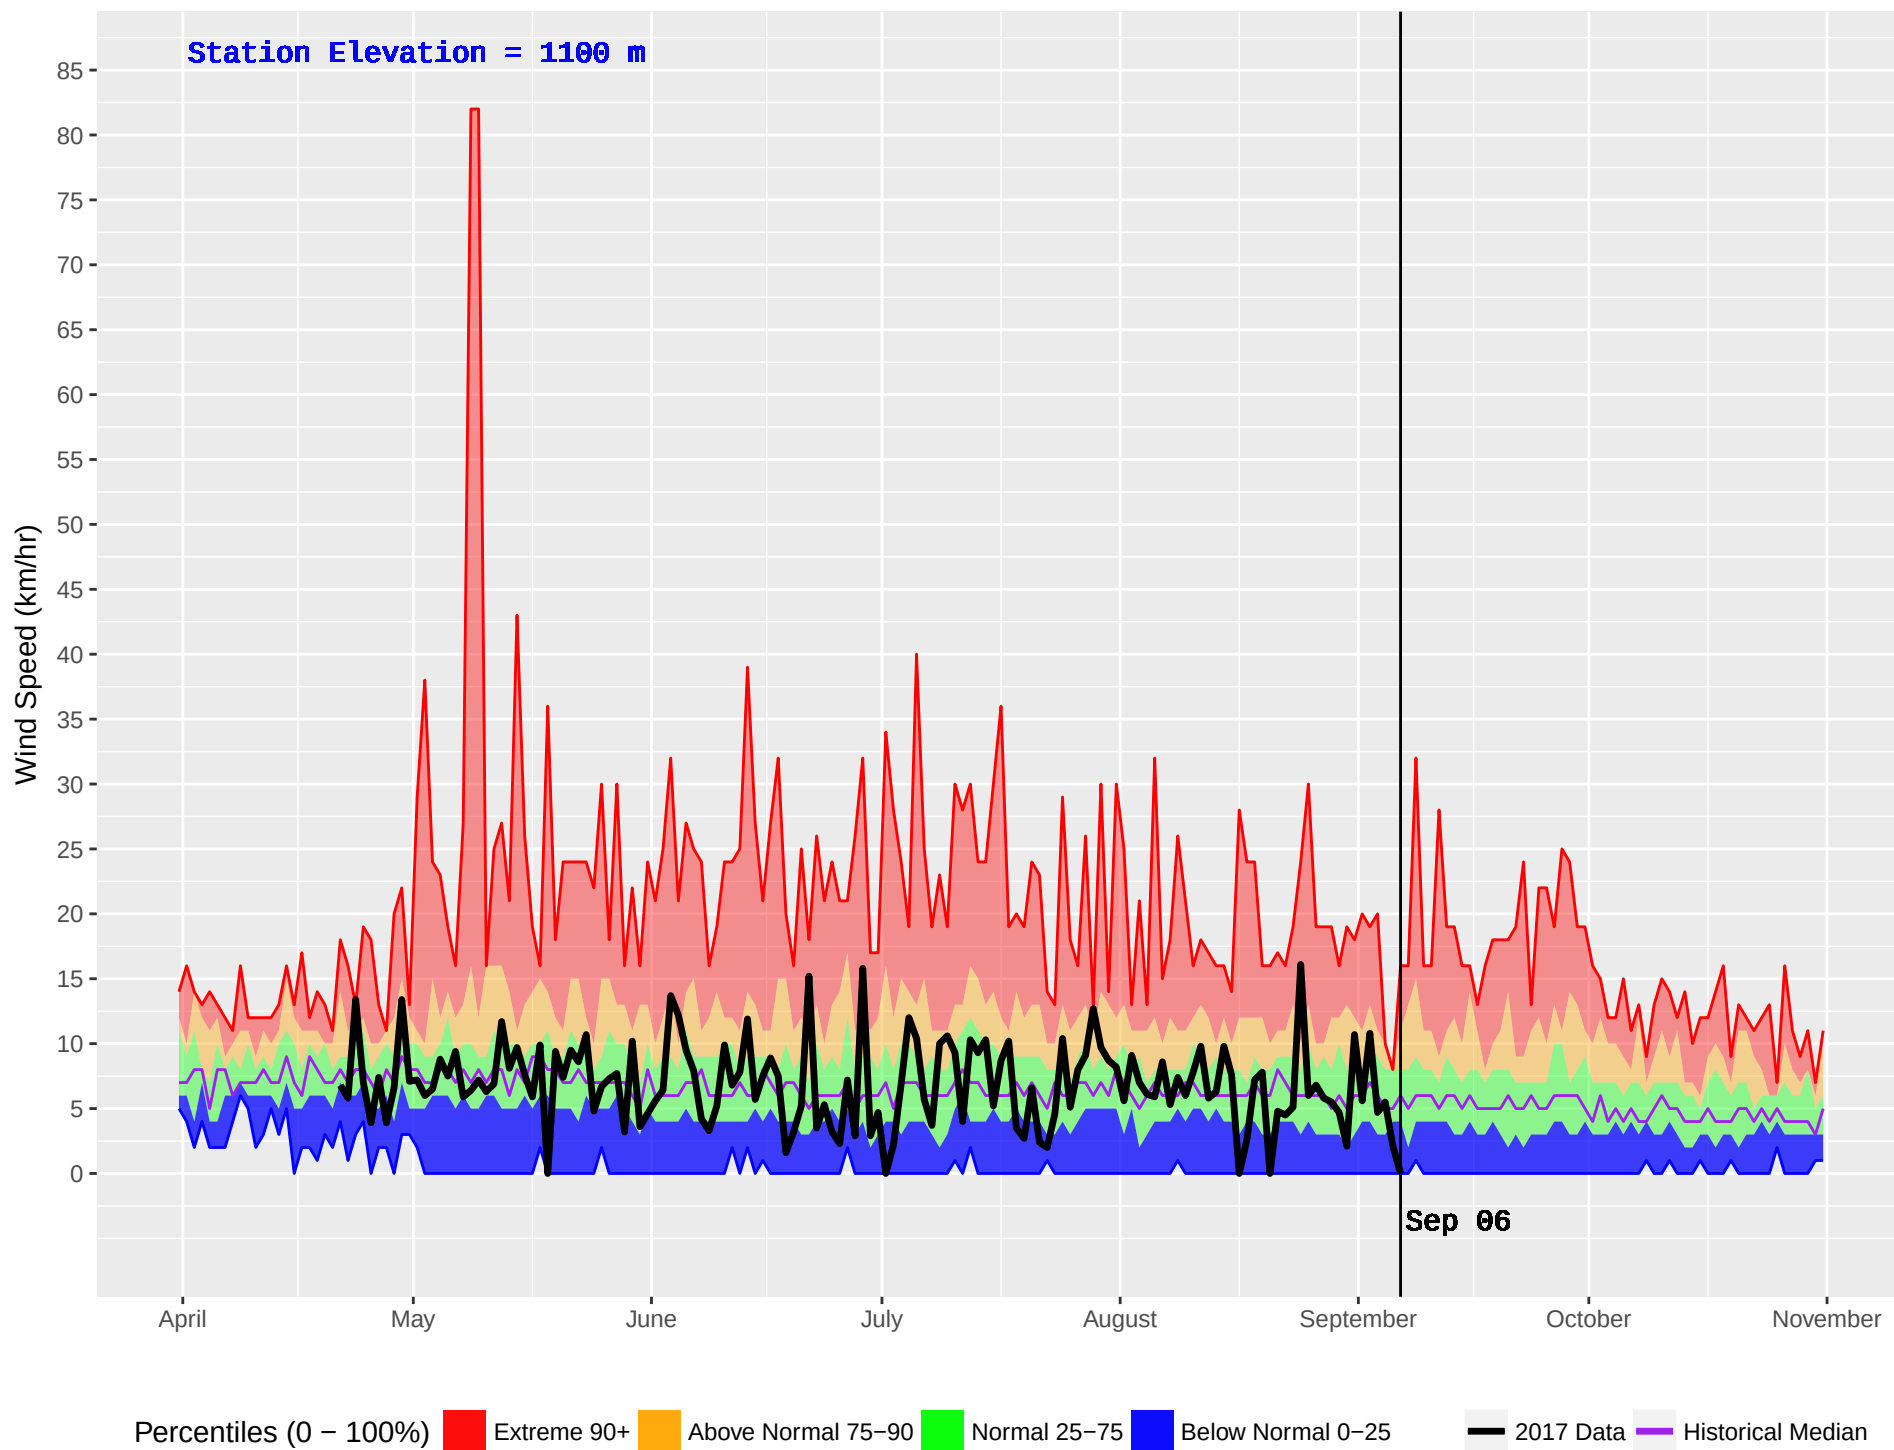

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Cumulative Precipitation

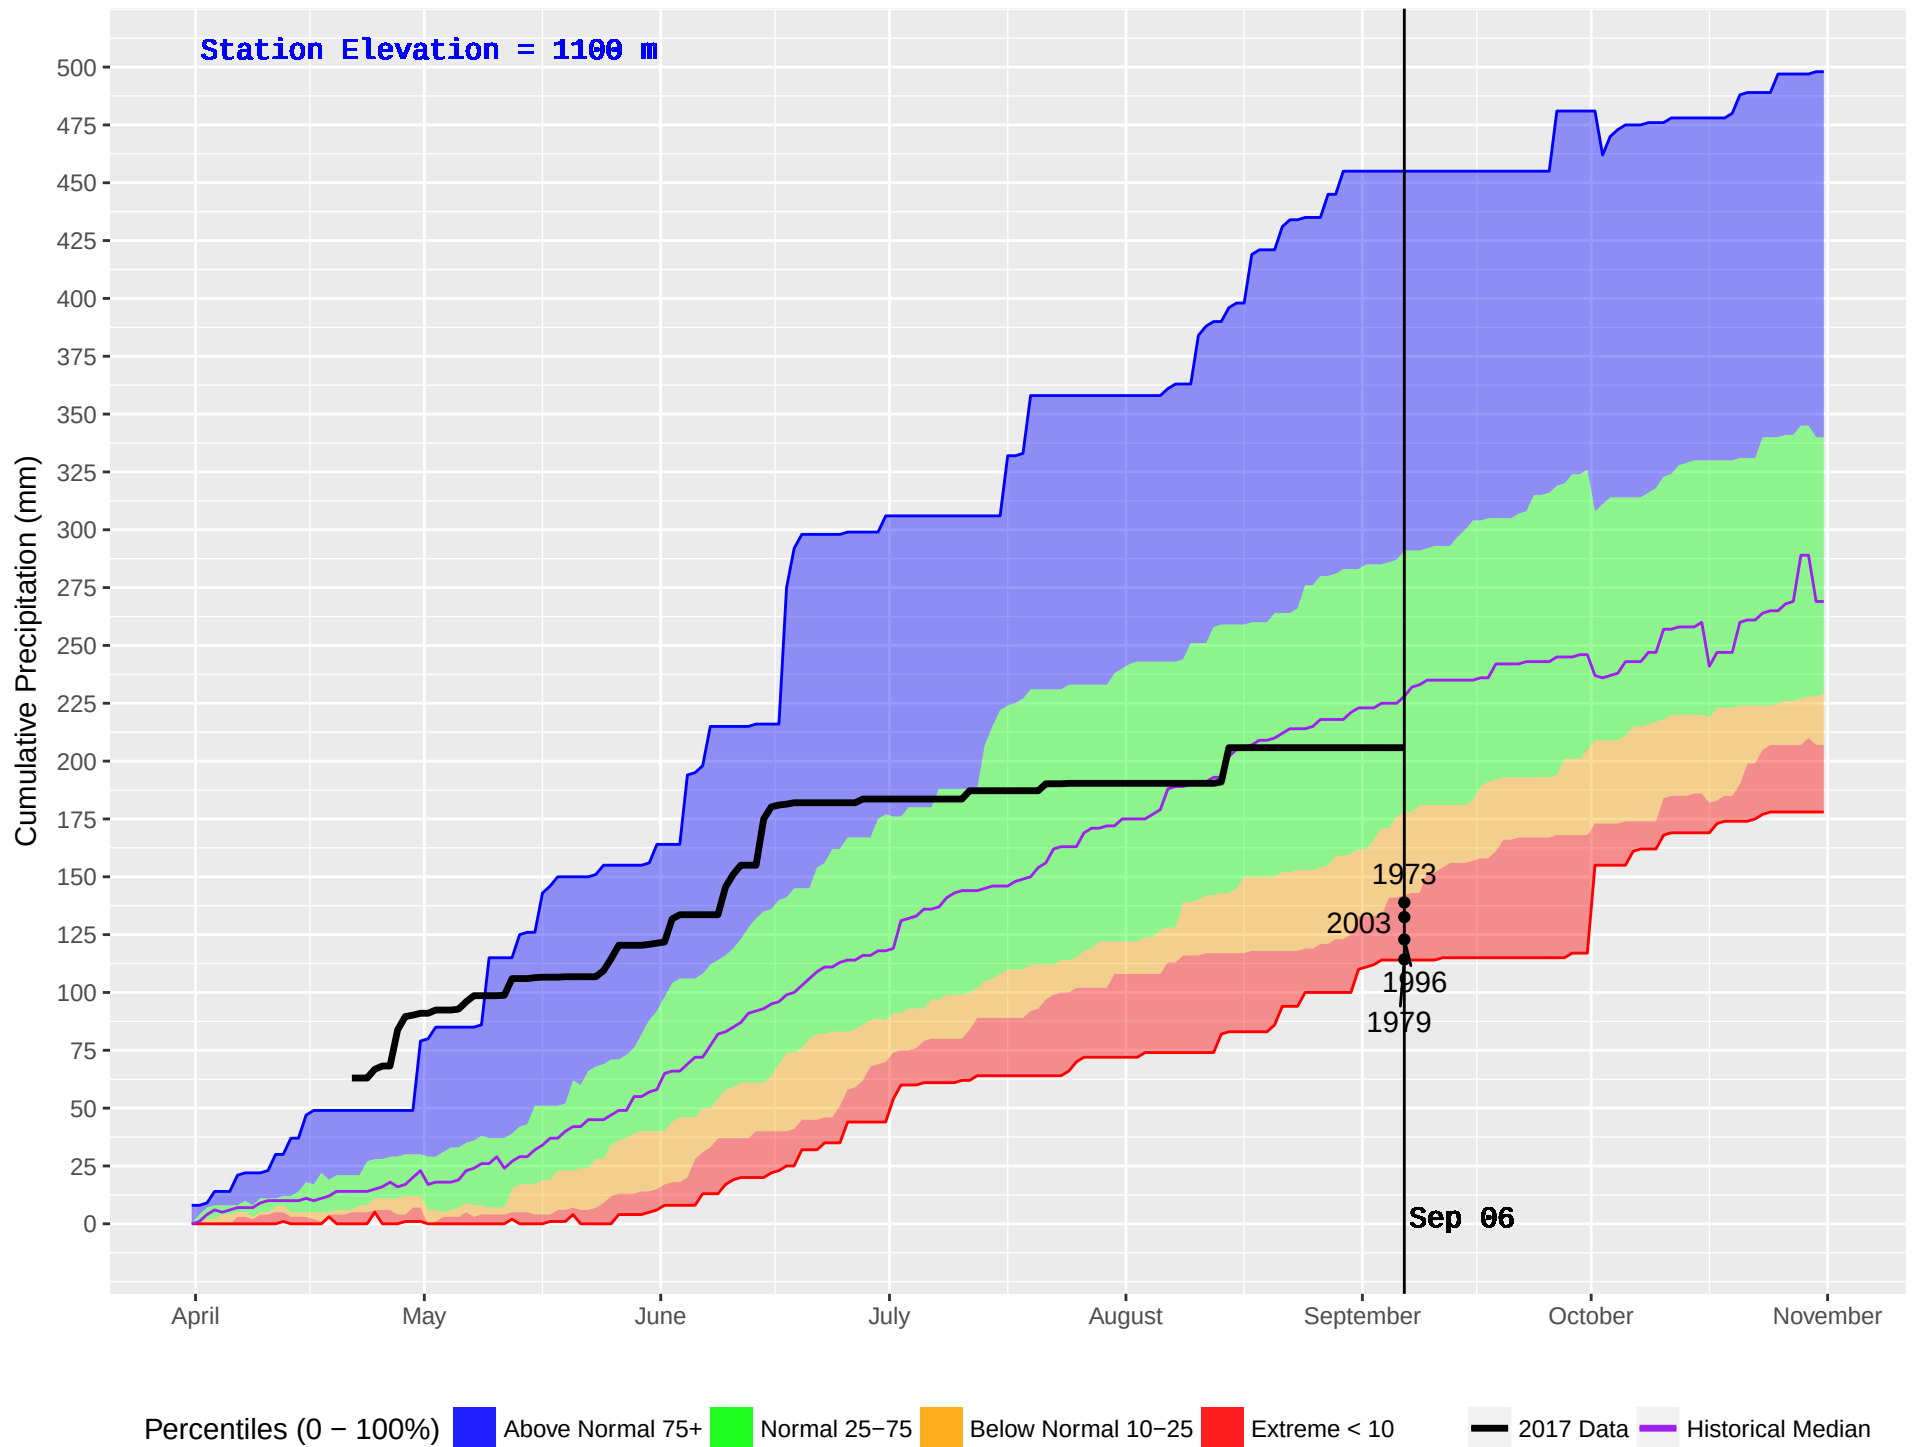

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Fine Fuel Moisture Code (FFMC)

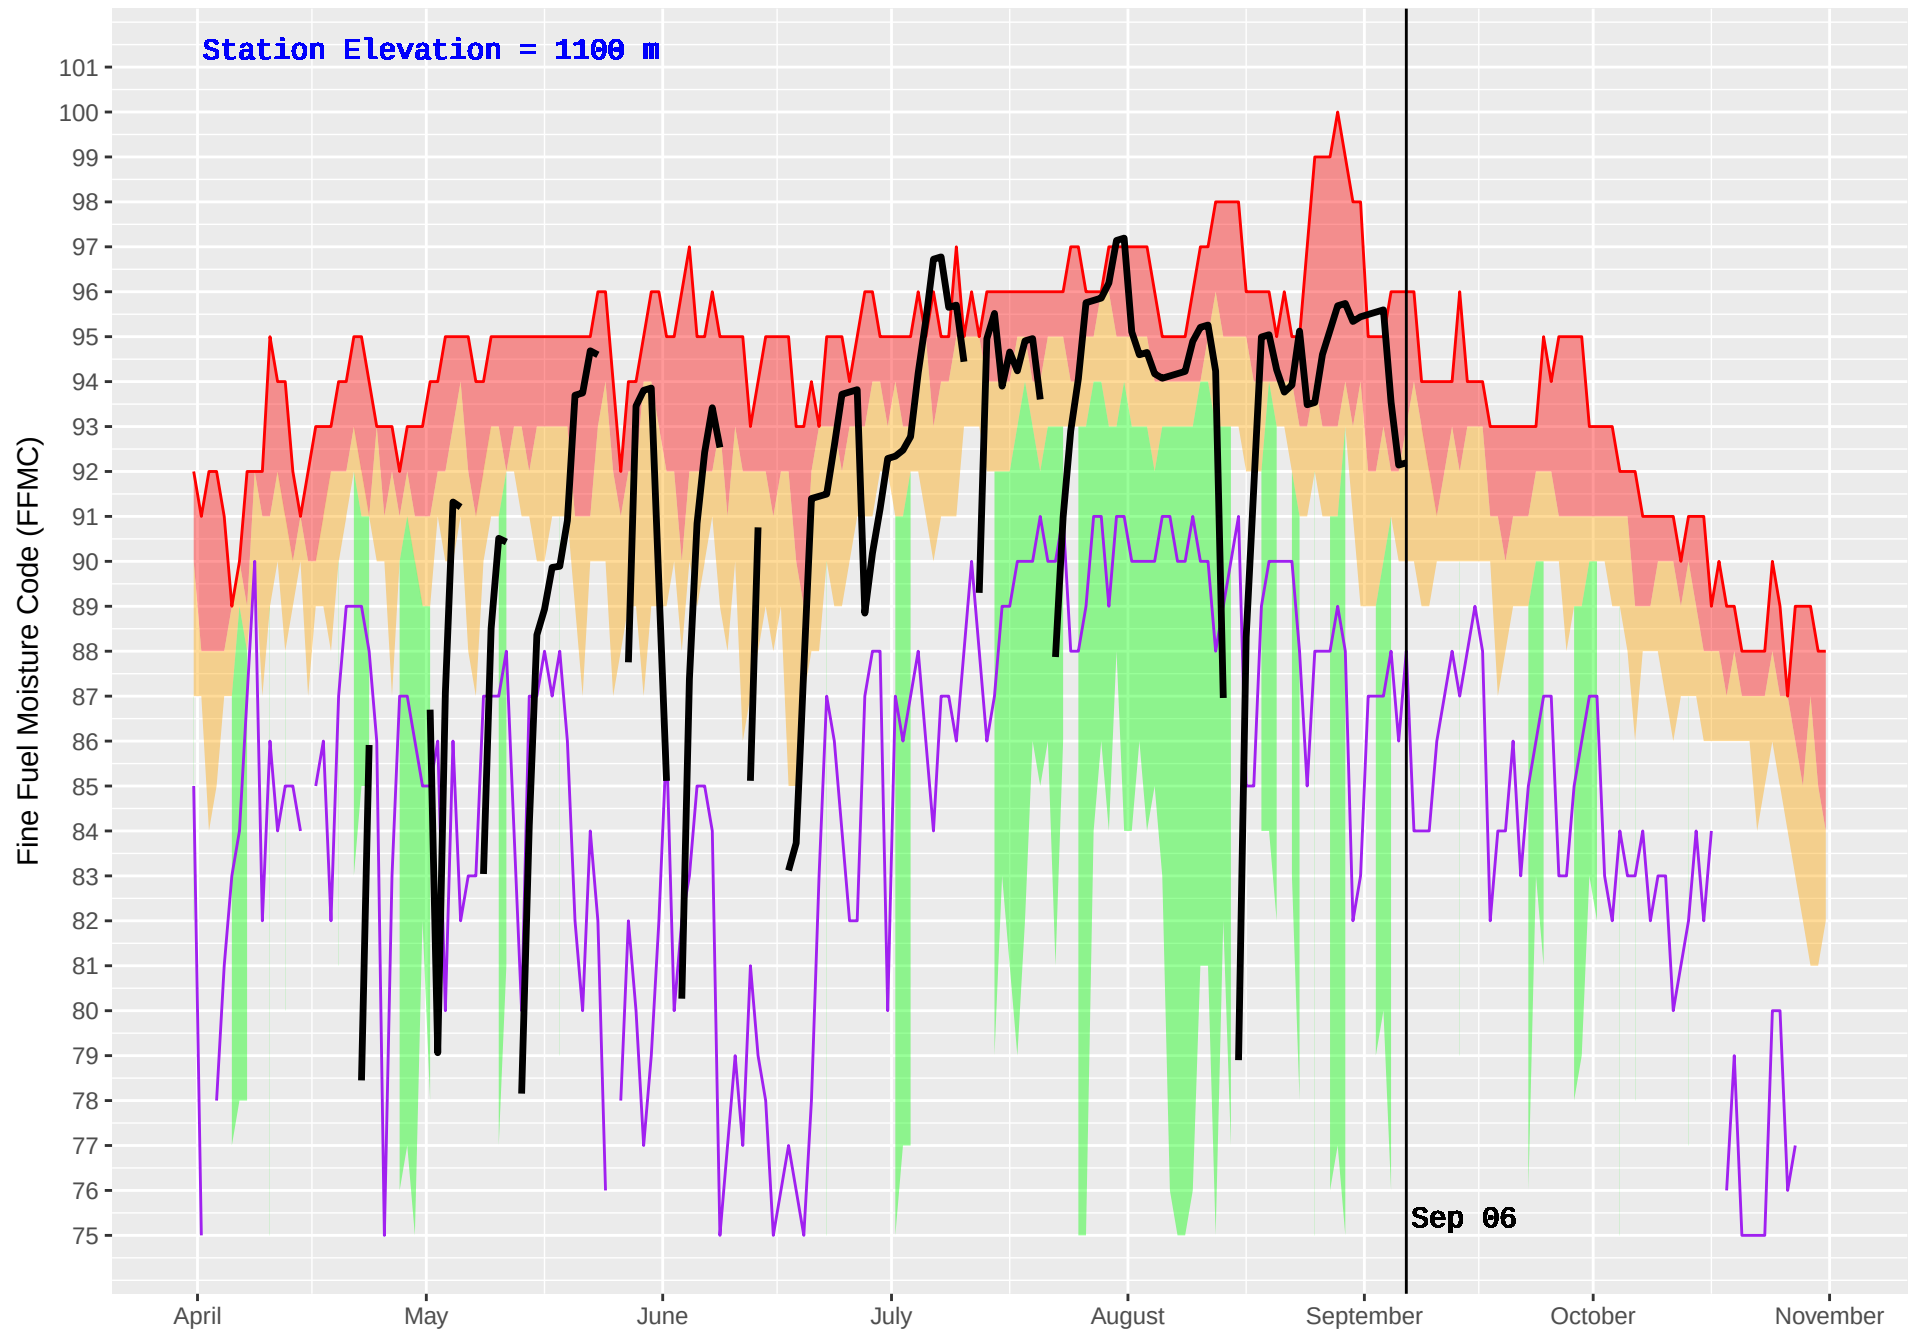

Percentiles (0 – 100%)

Extreme 90+

Above Normal 75-90


Normal 25-75

Below Normal 0-25

2017 Data

Historical Median

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Duff Moisture Code (DMC)

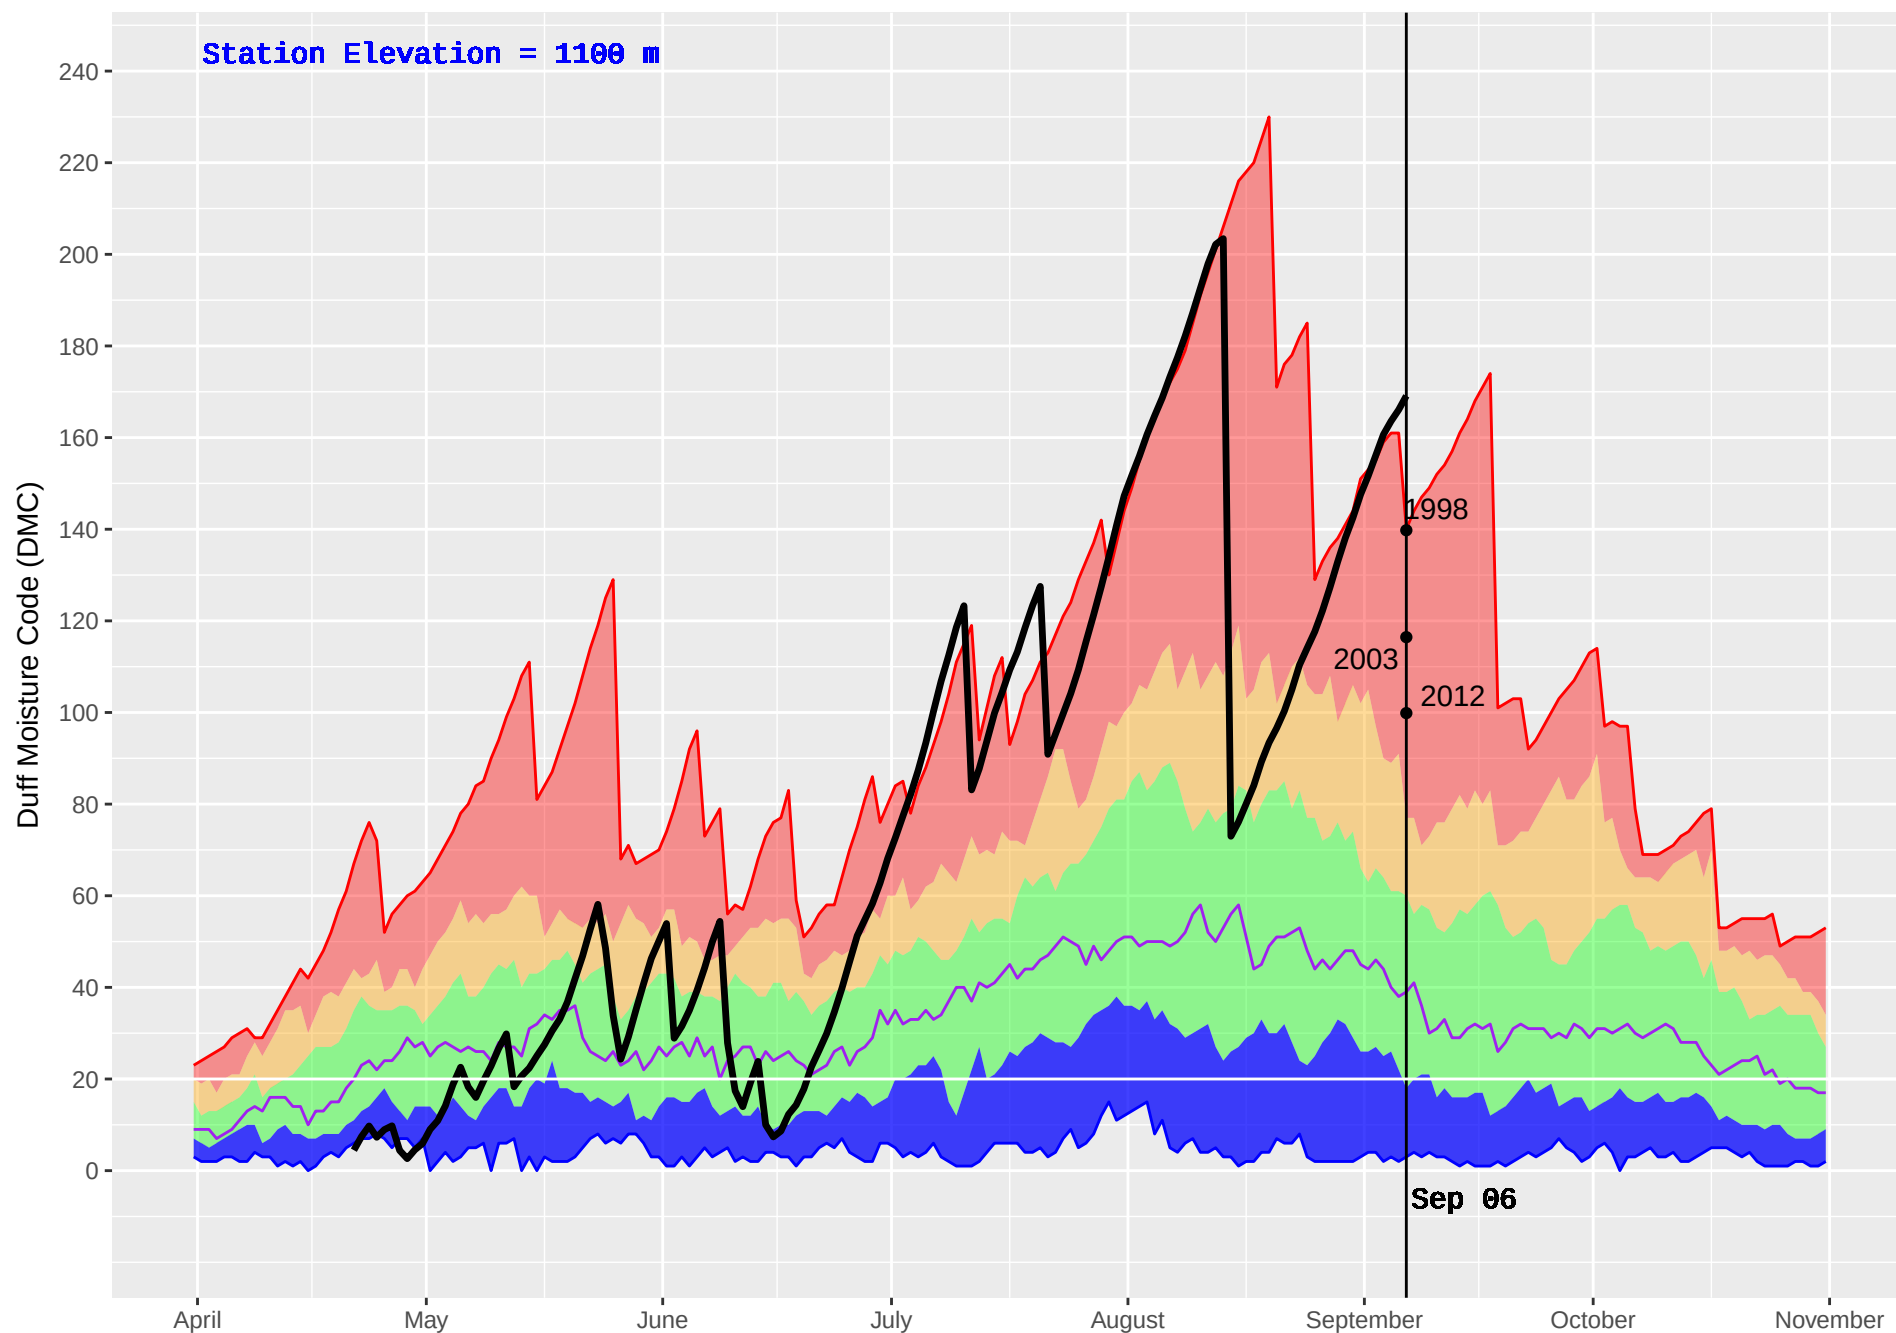

Percentiles (0 – 100%)

Extreme 90+

Above Normal 75–90


Normal 25–75

Below Normal 0–25


2017 Data

Historical Median

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Drought Code (DC)

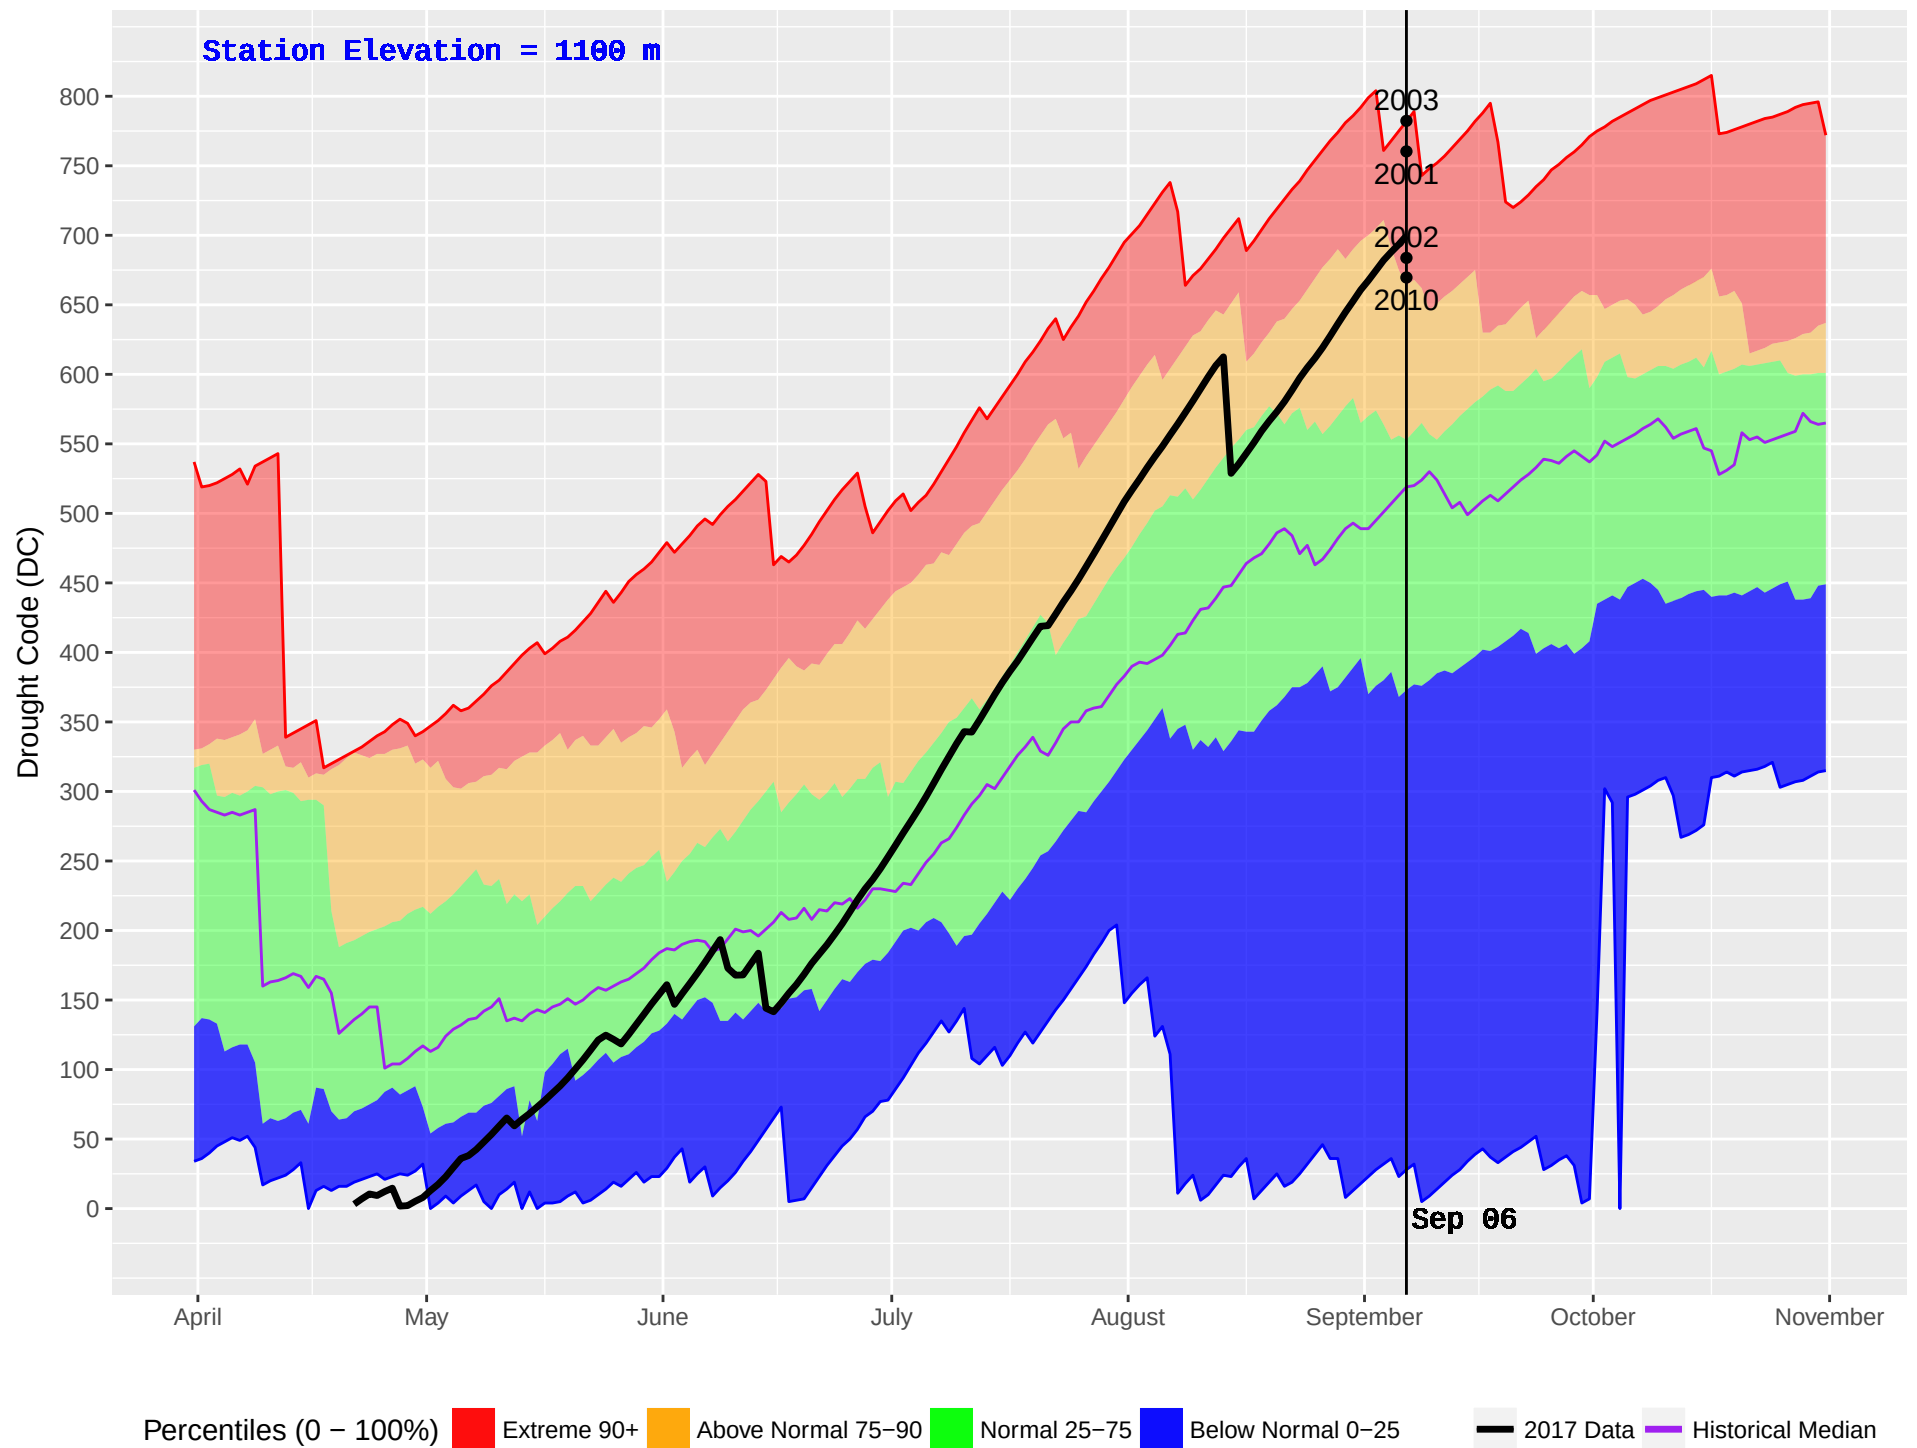

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Initial Spread Index (ISI)

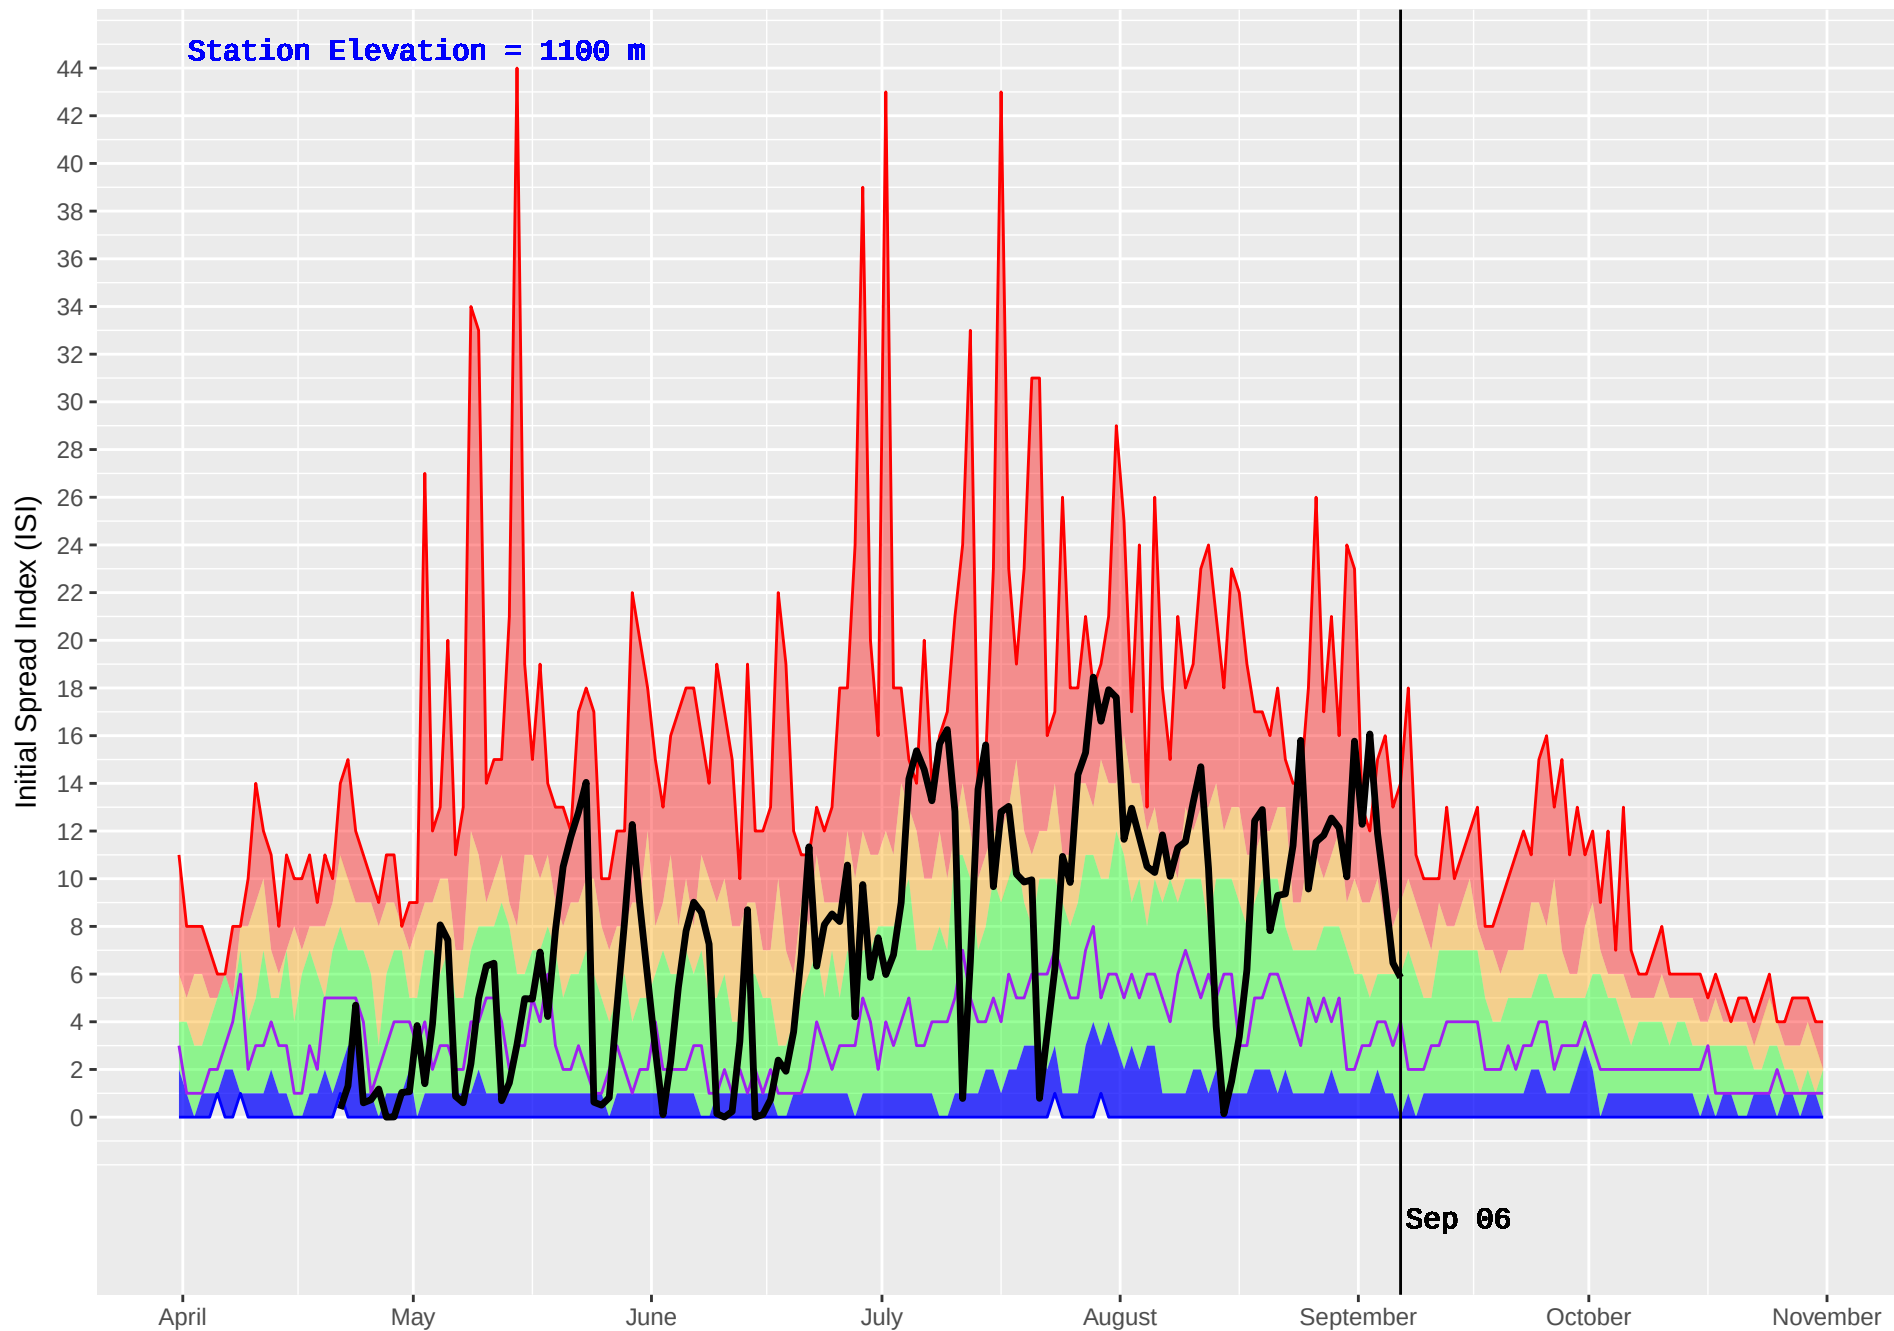

Percentiles (0 – 100%)

Extreme 90+

Above Normal 75–90


Normal 25–75

Below Normal 0–25


2017 Data

Historical Median

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Buildup Index (BUI)

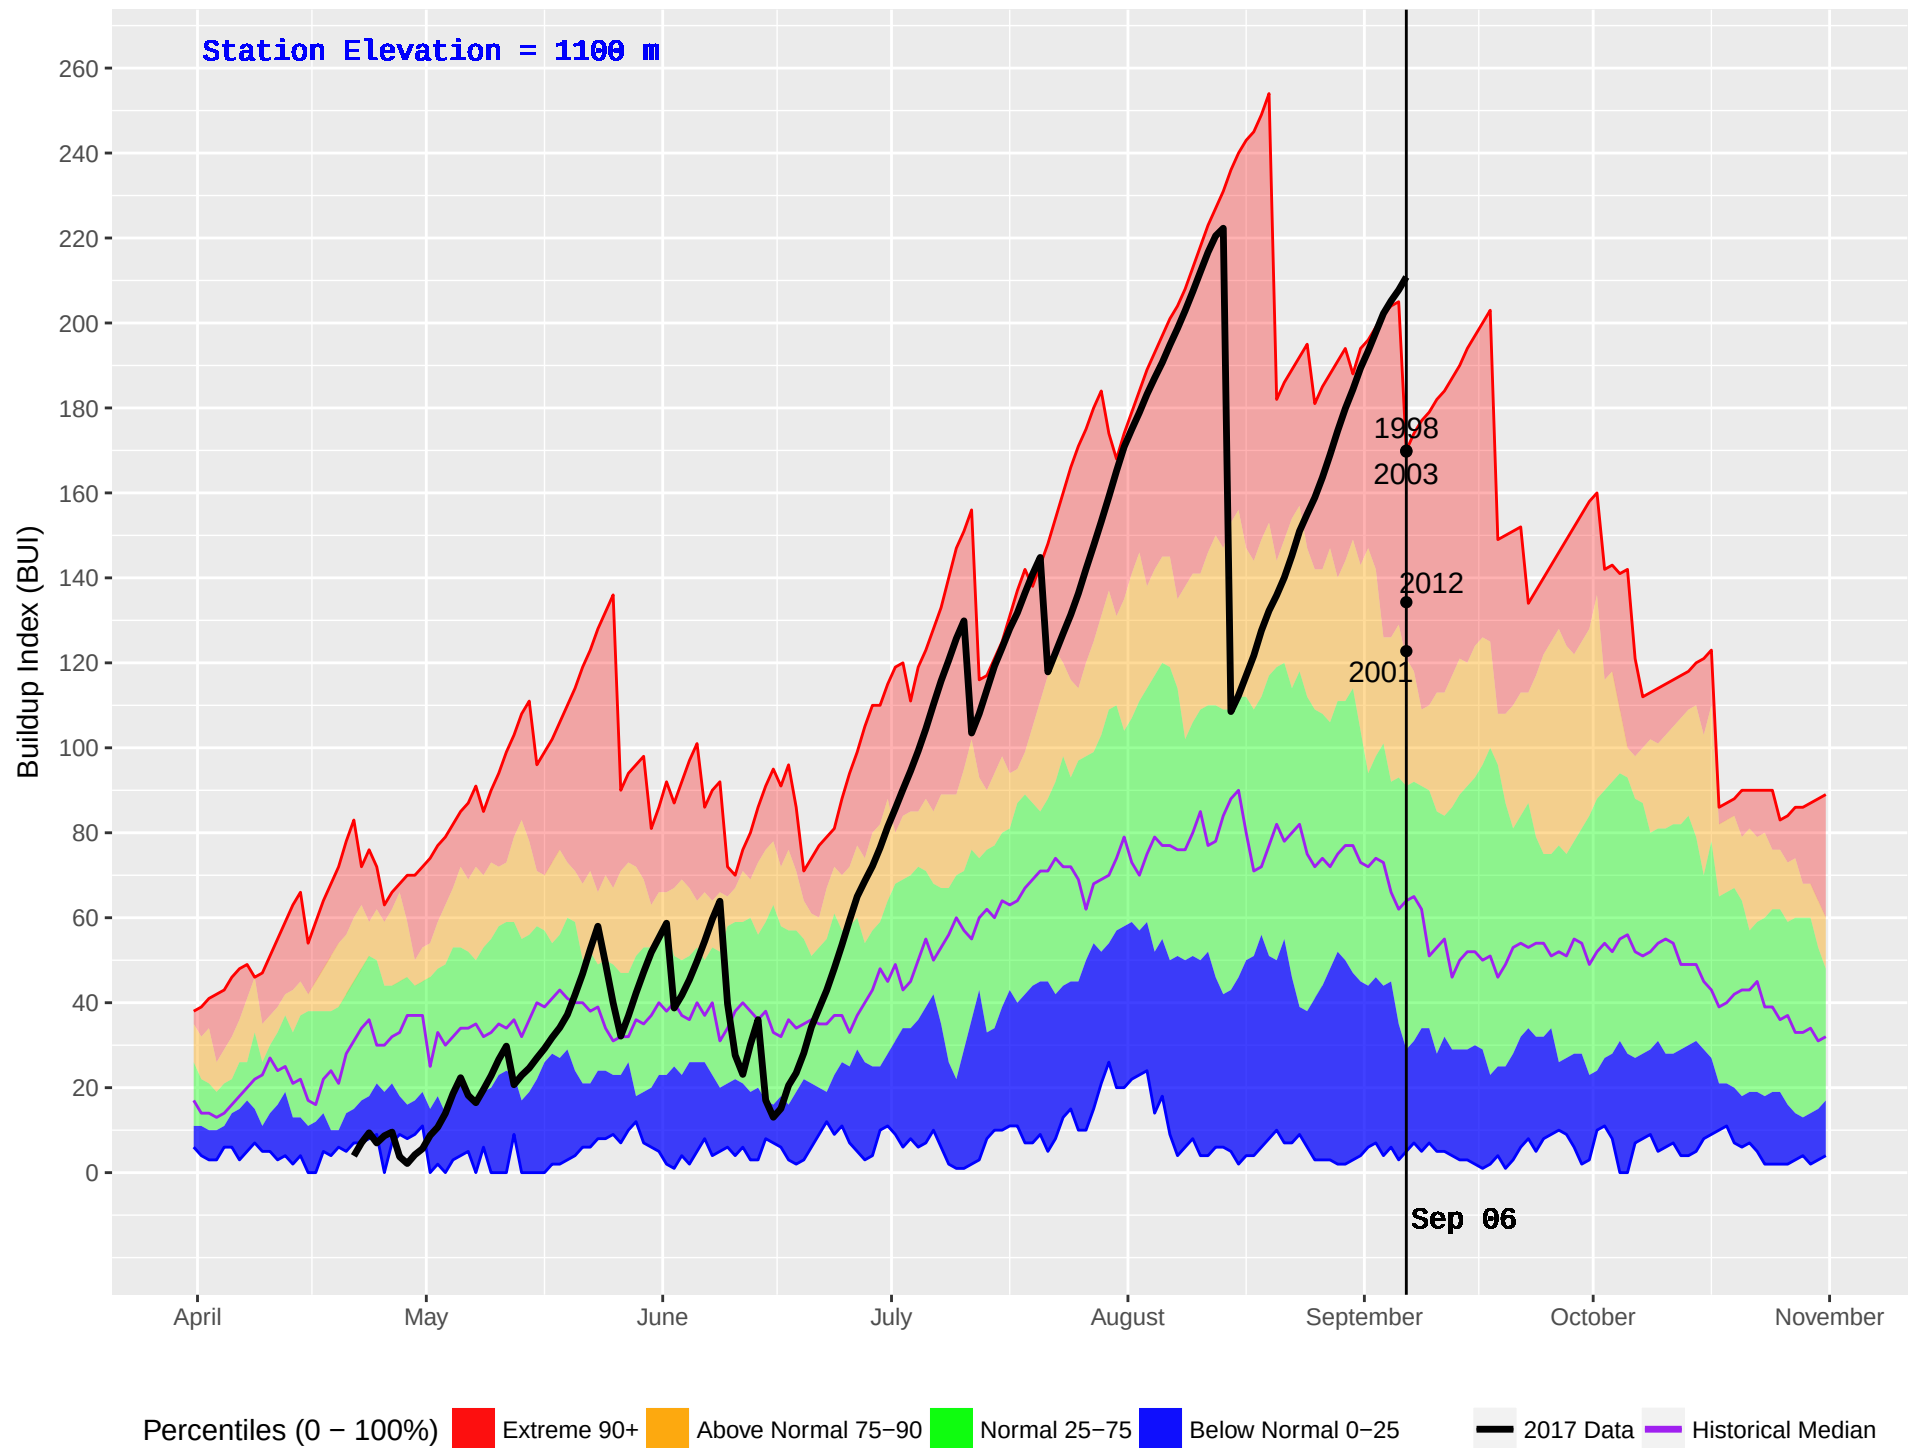

PALLISER (411) : Historical (1973–2016) and Current (2017) Noon Fire Weather Index (FWI)

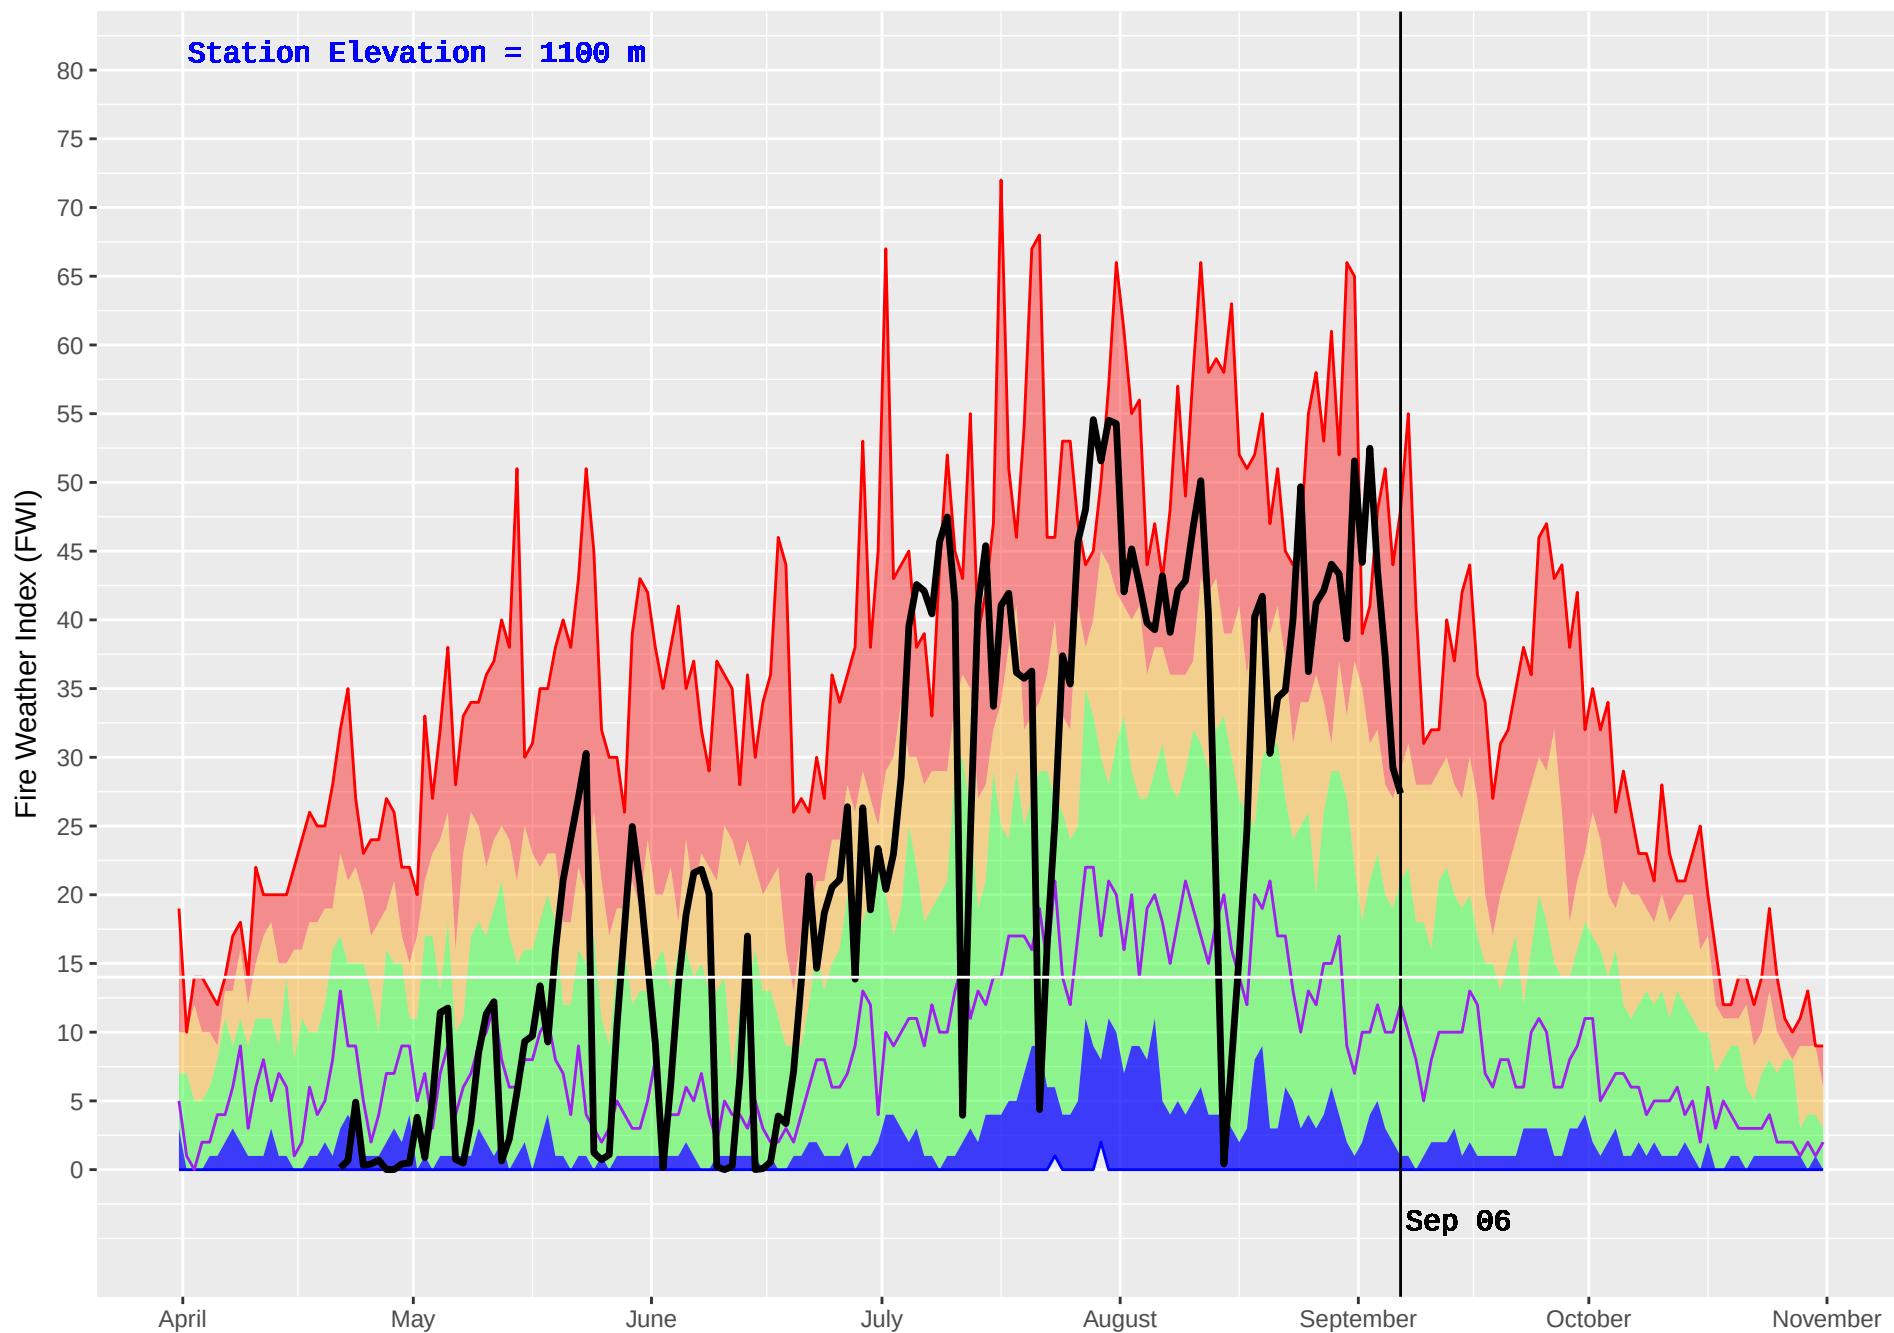

Percentiles (0 – 100%) **Extreme 90+** **Above Normal 75–90** **Normal 25–75** **Below Normal 0–25** **2017 Data** **Historical Median**

For Questions/Comments/Suggestions Contact:

Brad Armitage

Ember Research Services Ltd.

(250) 213-2600

Brad.Armitage@EmberResearch.com